




# Certificate of Analysis

Sample: DE40514020-001  
Seed to Sale# 1A4000B00010D25000004881  
Sample Size Received: 22 gram  
Servings: 1  
Ordered: 05/14/24  
Sampled: 05/14/24  
Completed: 05/16/24

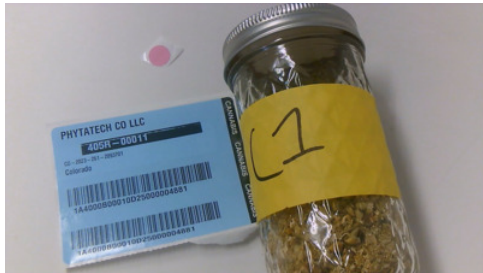

May 16, 2024 | WRCO Inc  
License # 405R-00011  
2452 S. Trenton Way,  
Denver, Colorado, 80231


**PASSED**

Pages 1 of 1

**SAFETY RESULTS**

									
Pesticides NOT TESTED	Heavy Metals NOT TESTED	Microbials NOT TESTED	Mycotoxins NOT TESTED	Residuals Solvents NOT TESTED	Filtration NOT TESTED	Water Activity NOT TESTED	Moisture NOT TESTED	Homogeneity Testing NOT TESTED	Miscellaneous NOT TESTED

**Cannabinoid** **PASSED**

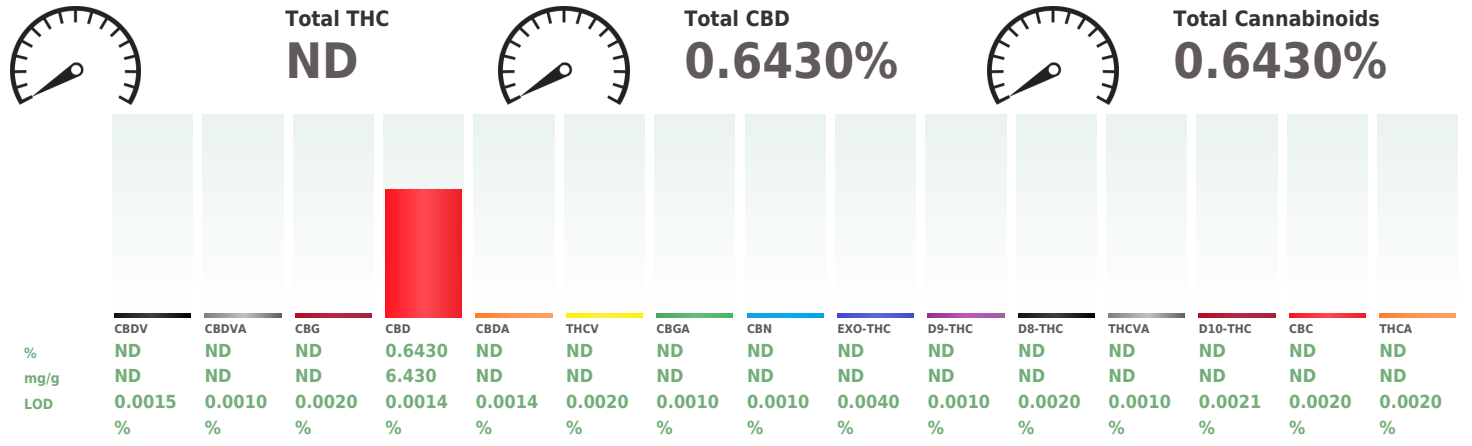

Analyzed by: 2721, 8, 2791, 3313      Weight: 1.9786g      Extraction date: 05/15/24 11:09:33      Extracted by: 2813

Analysis Method : SOP.T.40.039.CO      Analytical Batch : DE007815POT      Reviewed On : 05/16/24 15:39:45  
Instrument Used : Shimadzu LC-2030C 3D Plus Ted      Batch Date : 05/15/24 09:38:25

Dilution : 20  
Reagent : 051424.R01  
Consumables : 0000186393; 319121051; 060623CH01; 923C4-923AK; 61572-107C6-107H; 22082065; 2014919  
Pipette : N/A

Full spectrum cannabinoid analysis utilizing High Performance Liquid Chromatography with DAD detection (HPLC-UV). Method SOP.T.90.010.CO for reporting. Lower limit of linearity for all cannabinoids is 1 mg/L.

This report shall not be reproduced, unless in its entirety, without written approval from Kaycha Labs. This report is a Kaycha Labs certification. The results relate only to the material received or product analyzed. Test results are confidential unless explicitly waived otherwise. Void after 1 year from test end date. Cannabinoid or contaminant content of batch material may vary depending on sampling error. ND=Not Detected, NT=Not Tested, ppm=Parts Per Million, ppb=Parts Per Billion. Limit of Detection (LoD) and Limit Of Quantitation (LoQ) are terms used to describe the smallest concentration that can be reliably measured by an analytical procedure. RPD=Reproducibility of two measurements. Action Levels are State determined thresholds. The Measurement Uncertainty (UM) error is available from the lab upon request.

**Stephen Goldman**  
Lab Director  
State License # 405R-00011  
405-00008  
ISO 17025 Accreditation # 4331.01



Signature  
05/16/24